13/11/2012 www.crouzet.com



Single function phase control relay - 17.5 mm MWS Part number 84873020



- Control of 3-phase networks : phase sequence, total phase failure
- Multi-voltage from 3 x 208 to 3 x 480 V AC
- Controls its own supply voltage
- True RMS measurement
- LED status indication

| Part numbers | | | | |
|--------------|------|----------------------------|-----------------------|--------------------------------|
| | | | | |
| | Type | Function | Nominal voltage (V) | Output |
| 84873020 | MWS | Phase sequence and failure | 3 x 208 →3 x 480 V AC | 1 single pole changeover relay |
| | | | | |
| | | | | |

| | Type | Function | Nominal voltage (V) | Output | |
|---|----------------|--------------------------------|--|--------------------------------|--|
| 84873020 | MWS | Phase sequence and failure | 3 x 208 →3 x 480 V AC | 1 single pole changeover relay | |
| | | | | | |
| 2 | | | | | |
| Specificatio | ns | | | | |
| Supply | | | | | |
| Voltage supp | oly tolerand | ce | -12 % / +10 % | | |
| AC supply vo | | | 50 / 60 Hz ± 10 % | | |
| Galvanic isol | lation of po | ower supply/measurement | No | | |
| Power consu | ımption at | Un | 22 VA in 400 VAC, 50 Hz | | |
| Immunity from | m micro po | ower cuts | 60 ms | | |
| Inputs and I | measurin | ng circuit | | | |
| | | ure detection threshold | < 100 V AC | | |
| Frequency of | f measure | d signal | 50 →60 Hz ± 10 % | | |
| Timing | | | | | |
| Delay on pick | k-up | | ≤650 ms | | |
| Alarm on dela | | IX. | 130 ms | | |
| Output | | | | | |
| Type of cont | acts | | No cadmium | | |
| Maximum bre | | age | 250 V AC / DC | | |
| Max. breakin | | | 5 A AC/DC | | |
| Min. breaking | g current | | 10 mA / 5 V DC | | |
| Electrical life | (number c | of operations) | 1 x 10 ⁵ MWS | | |
| | | | 1 x 10 ⁴ MWS2 | | |
| Breaking cap | pacity (resi | istive) | 1250 VA AC | | |
| Maximum rate | | | 360 operations/hour at full load | | |
| Operating car | tegories ac | cc. to IEC/EN 60947-5-1 | AC12, AC13, AC14, AC15, DC12, DC13 | | |
| Mechanical li | ife (operati | ions) | 30 x 10 ⁶ | | |
| Insulation | | | - 00 X 10 | | |
| | lation voltage | ge IEC/EN 60664-1 | 400 V | | |
| | | IEC/EN 60664-1) | Overvoltage category III : degree of pollution 3 | | |
| Rated impuls | e withstand | d voltage (IEC/EN 60664-1) | 4 kV (1,2 / 50 µs) | | |
| Dielectric strength (IEC/EN 60664-1) | | EN 60664-1) | 2 kV AC 50 Hz 1 min. | | |
| Insulation resistance (IEC/EN 60664-1) | | | > 500 MΩ / 500 V DC | | |
| General cha | aracteris | tics | | | |
| Output relay | | | Yellow LED | | |
| Casing | | | 17,5 mm | | |
| Mounting | | | On 35 mm symmetrical DIN rail, IEC/EN 60715 | | |
| Mounting position | | | All positions | | |
| Material : enclosure plastic type VO to UL94 standard | | astic type VO to UL94 standard | Incandescent wire test according to IEC 60695-2-11 & NF EN 60695-2-11 | | |
| Protection (IE | C/EN 6052 | 29) | Terminal block : IP20 Casing : IP30 | | |
| Connecting c | apacity IEC | C/EN 60947-1 | Rigid : 1 x 4 ² - 2 x 2.5 ² mm ² 1 x 11 AWG - 2 x 14 AWG | | |

Flexible with ferrules : 1 x 2.5^2 - 2 x 1.5^2 mm²

1 x 14 AWG - 2 x 16 AWG 0,6 \rightarrow 1 Nm / 5,3 \rightarrow 8,8 Lbf.In

-20 →+50 °C -40 →+70 °C 13/11/2012 www.crouzet.com

| Humidity IEC/EN 60068-2-30 2 x 24 hr cycle 9 | 5 % RH max. without condensation 55 °C |
|---|--|
| Vibrations according to IEC/EN60068-2-6 10 →150 Hz, A = | 0.035 mm |
| Shocks IEC/EN 60068-2-6 5 g | |
| Standards | |
| Standards IECI/EN 50178, IE | C/EN 61000-6-2, IEC/EN 61000-6-3 |
| Certifications CE, UL, CSA, GL | |
| Conformity with environmental directives RoHS, WEEE | |

Supply

| Supply voltage Un | $3 \times 208 \rightarrow 3 \times 480 \text{ V AC}^*$ |
|------------------------------|--|
| Operating range | 183 →528 V AC |
| Inputs and measuring circuit | |
| Measurement ranges | 183 →528 V AC |
| General characteristics | |
| Weight | 80 g |
| | |

Comments

Accessories


| Description | Code |
|---|----------|
| Removable sealable cover for 17.5 mm casing | 84800000 |

Principles



Overview

3-phase network control relays monitor the sequence of phases L1, L2, L3 and failure of one or more phases. LEDs are used for signalling.

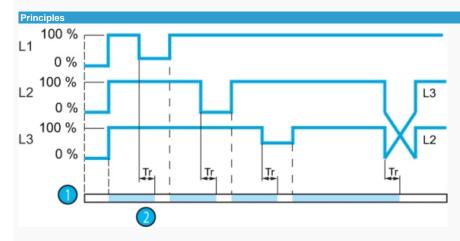

Operating principle MWS-MWS2 : Phase controller

The relay monitors its own supply voltage.

The relay controls :

- correct sequencing of the three phases,
- total failure of one of the three phases.

When the phase sequence and voltages are correct (> 183 VAC), the output relay (s) are closed and the yellow LED is lit.

In the event of a phase sequence or total phase failure fault (detected when one of the voltages drops below 100 V), the relay opens instantly and its LED is extinguished.


When the unit is powered up with a measured fault, the relay stays open.

| Nº | Legend |
|----|---|
| | MWS : Relay R MWS2 : Relays R1/R2 |
| 2 | Response time on appearance of a fault (Tr) |


Dimensions (mm)

MWS-MWS2

13/11/2012 www.crouzet.com

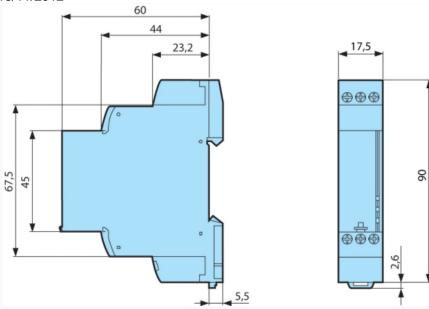

mm

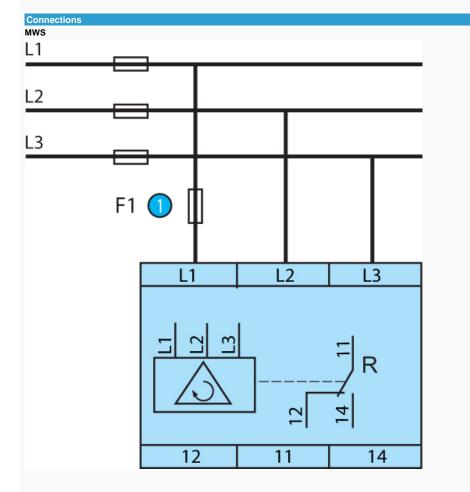

| Nº | Legend |
|----|-----------------------|
| 0 | 100 mA fast-blow fuse |

Product adaptations



Customisable colours and labels